



NHR-1500 Cable to Control Unit

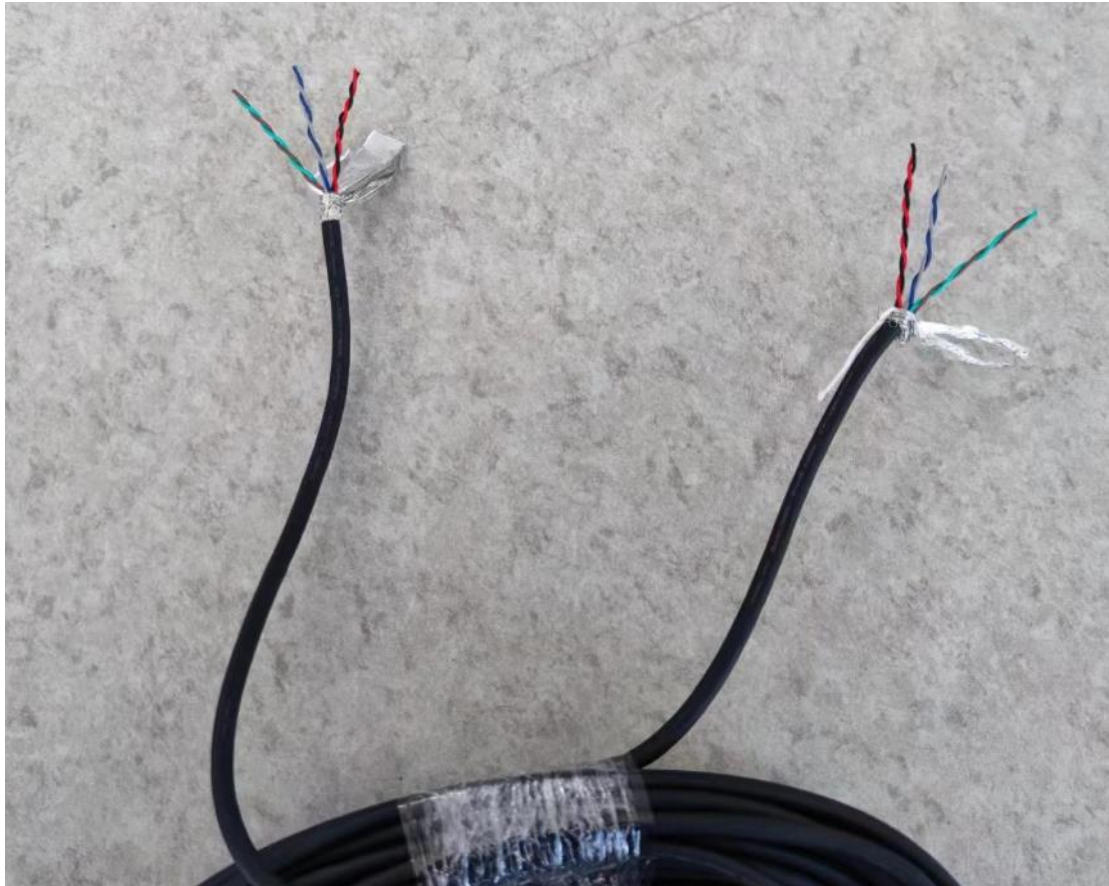


The cable should be twisted pair, and has shield.

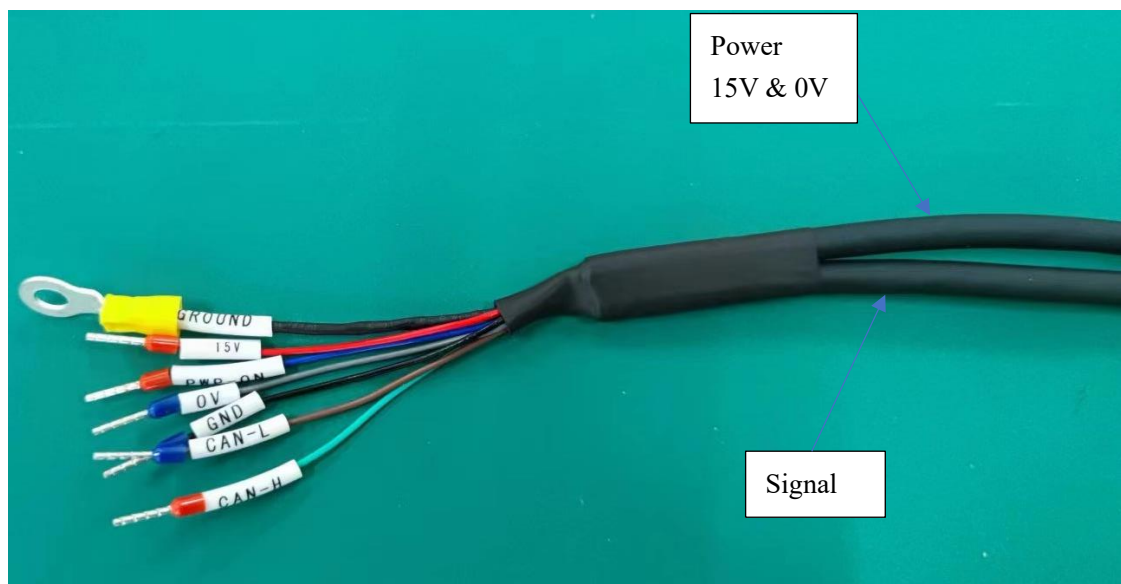

To Avoid power interference with signal, power cable and signal cable are separated.

CAN-H and CAN-L should be twisted pair.

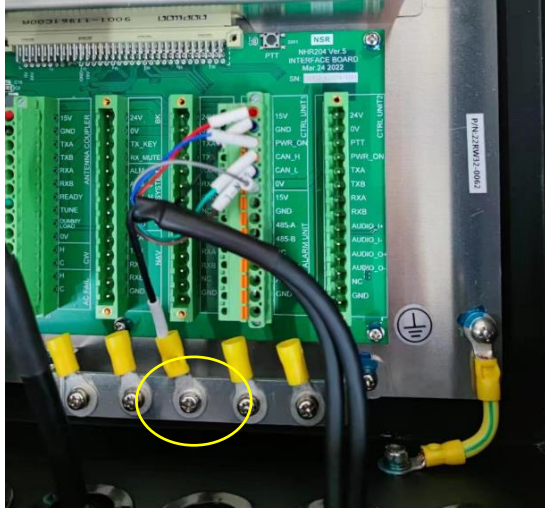

Confirm the shield of cable to control unit is well grounding.